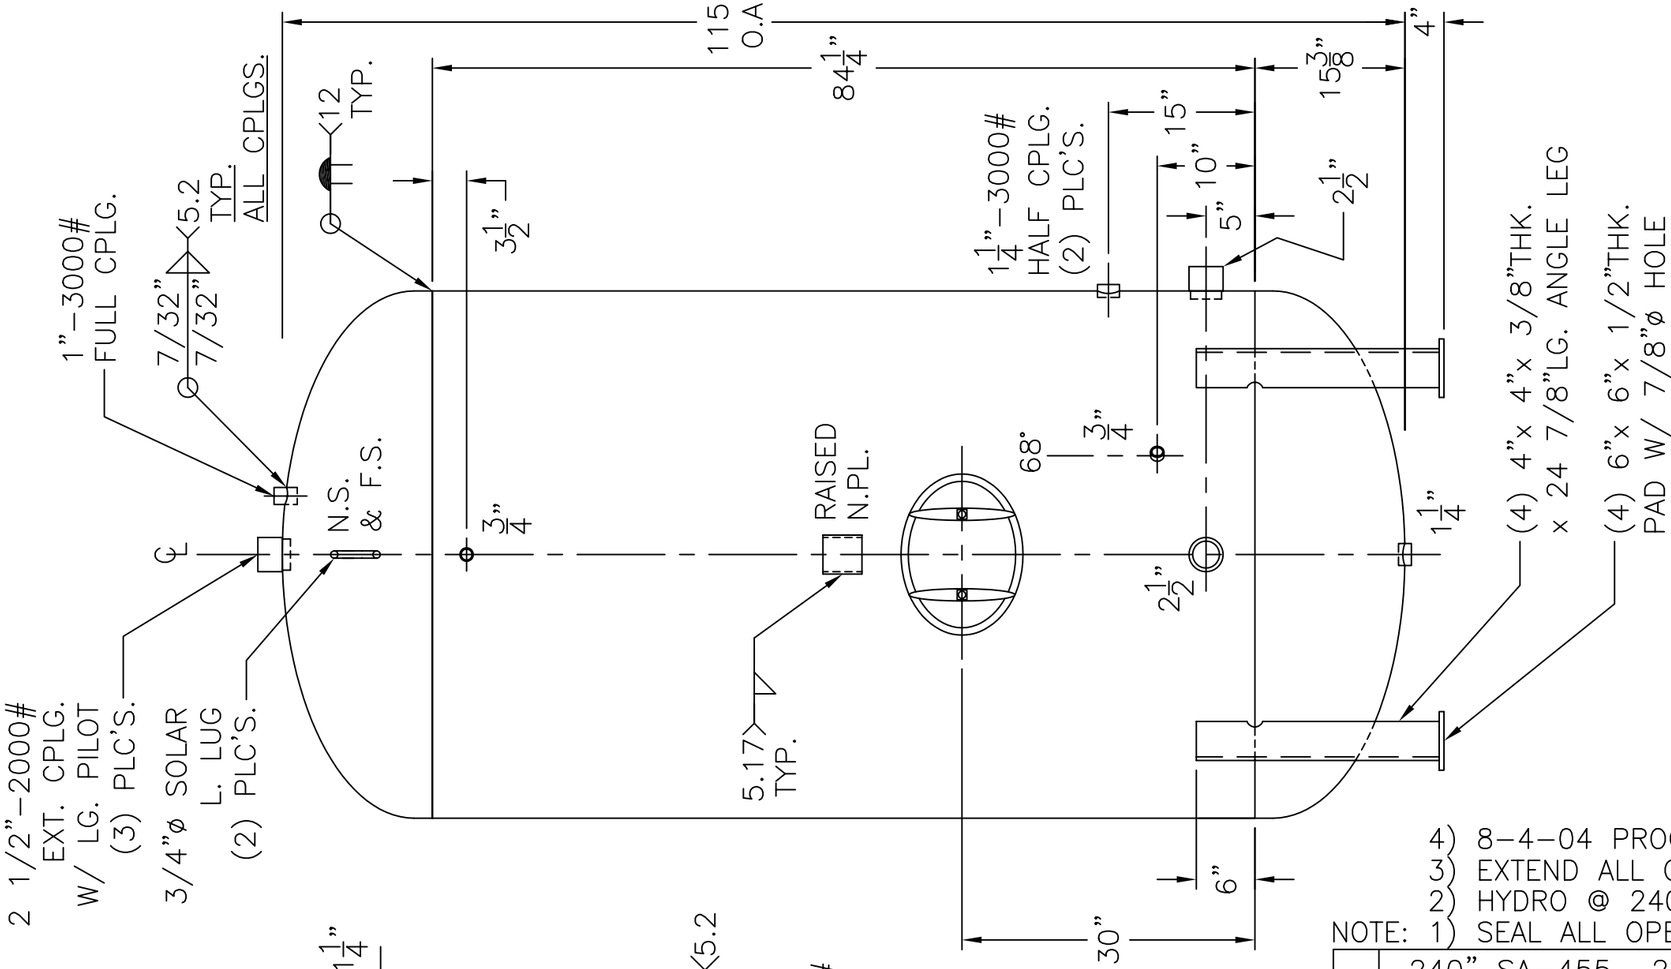

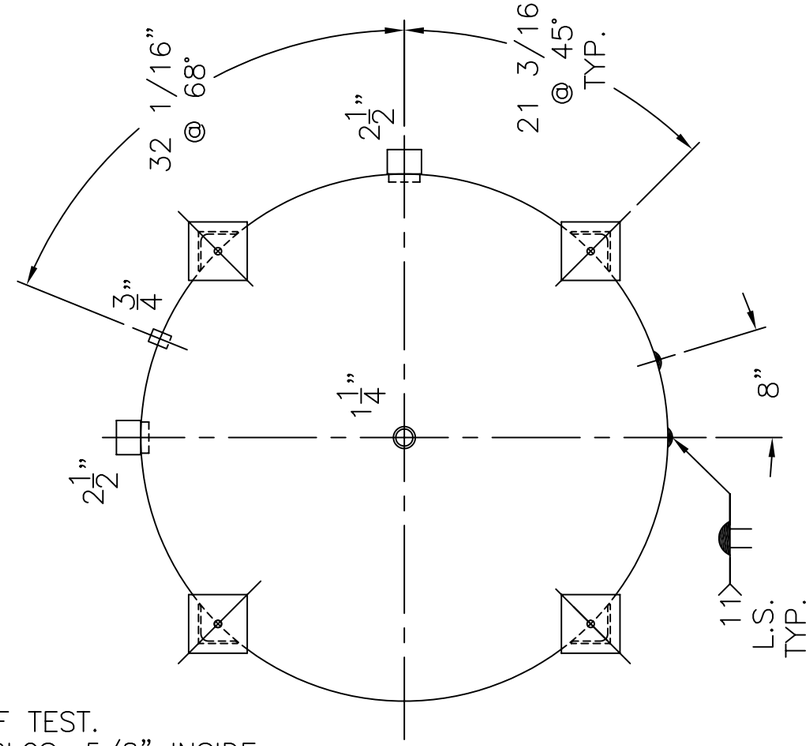

4) 8–4–04 PROOF TEST.
3) EXTEND ALL CPLGS. 5/8" INSIDE.
2) HYDRO @ 240 PSIG. MIN.
NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

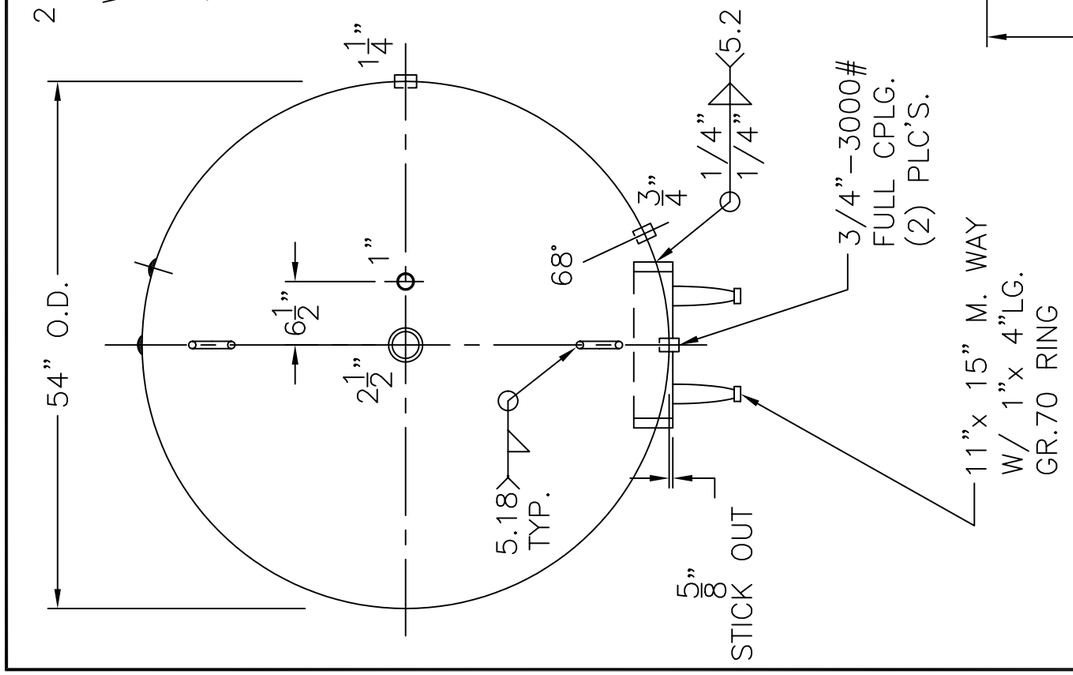

SHELL / HEADS: .240" SA–455 2:1 S.E.	CS–54–1040–V
JOGGLED	REV. 9–10–04
	DATE: 7–30–97
.225" SA–455	FOR: HANSON STANDARD
	VERT. HOT WATER TANK.
	146.1 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.
M.A.W.P. 160 PSIG. @ 210 °F	INSIDE: CEMENT LINED
	OUTSIDE: PRIME
ASME. SECTION IV 2001 ADD. 2003	(993) LEG–ZONE 4–15 KM.
X–RAY: RT–NO / H.L.W.	CAD–"B" UNDER "STD"–SERIES
GALLONS: 1040 WT. 2787 LBS.	BY: E.S. SCALE: 3/4" =1'
SERIAL NO.	ROY E. HANSON JR. MFG.
N.B.	1924 COMPTON AVE. LOS ANGELES, CA 90011