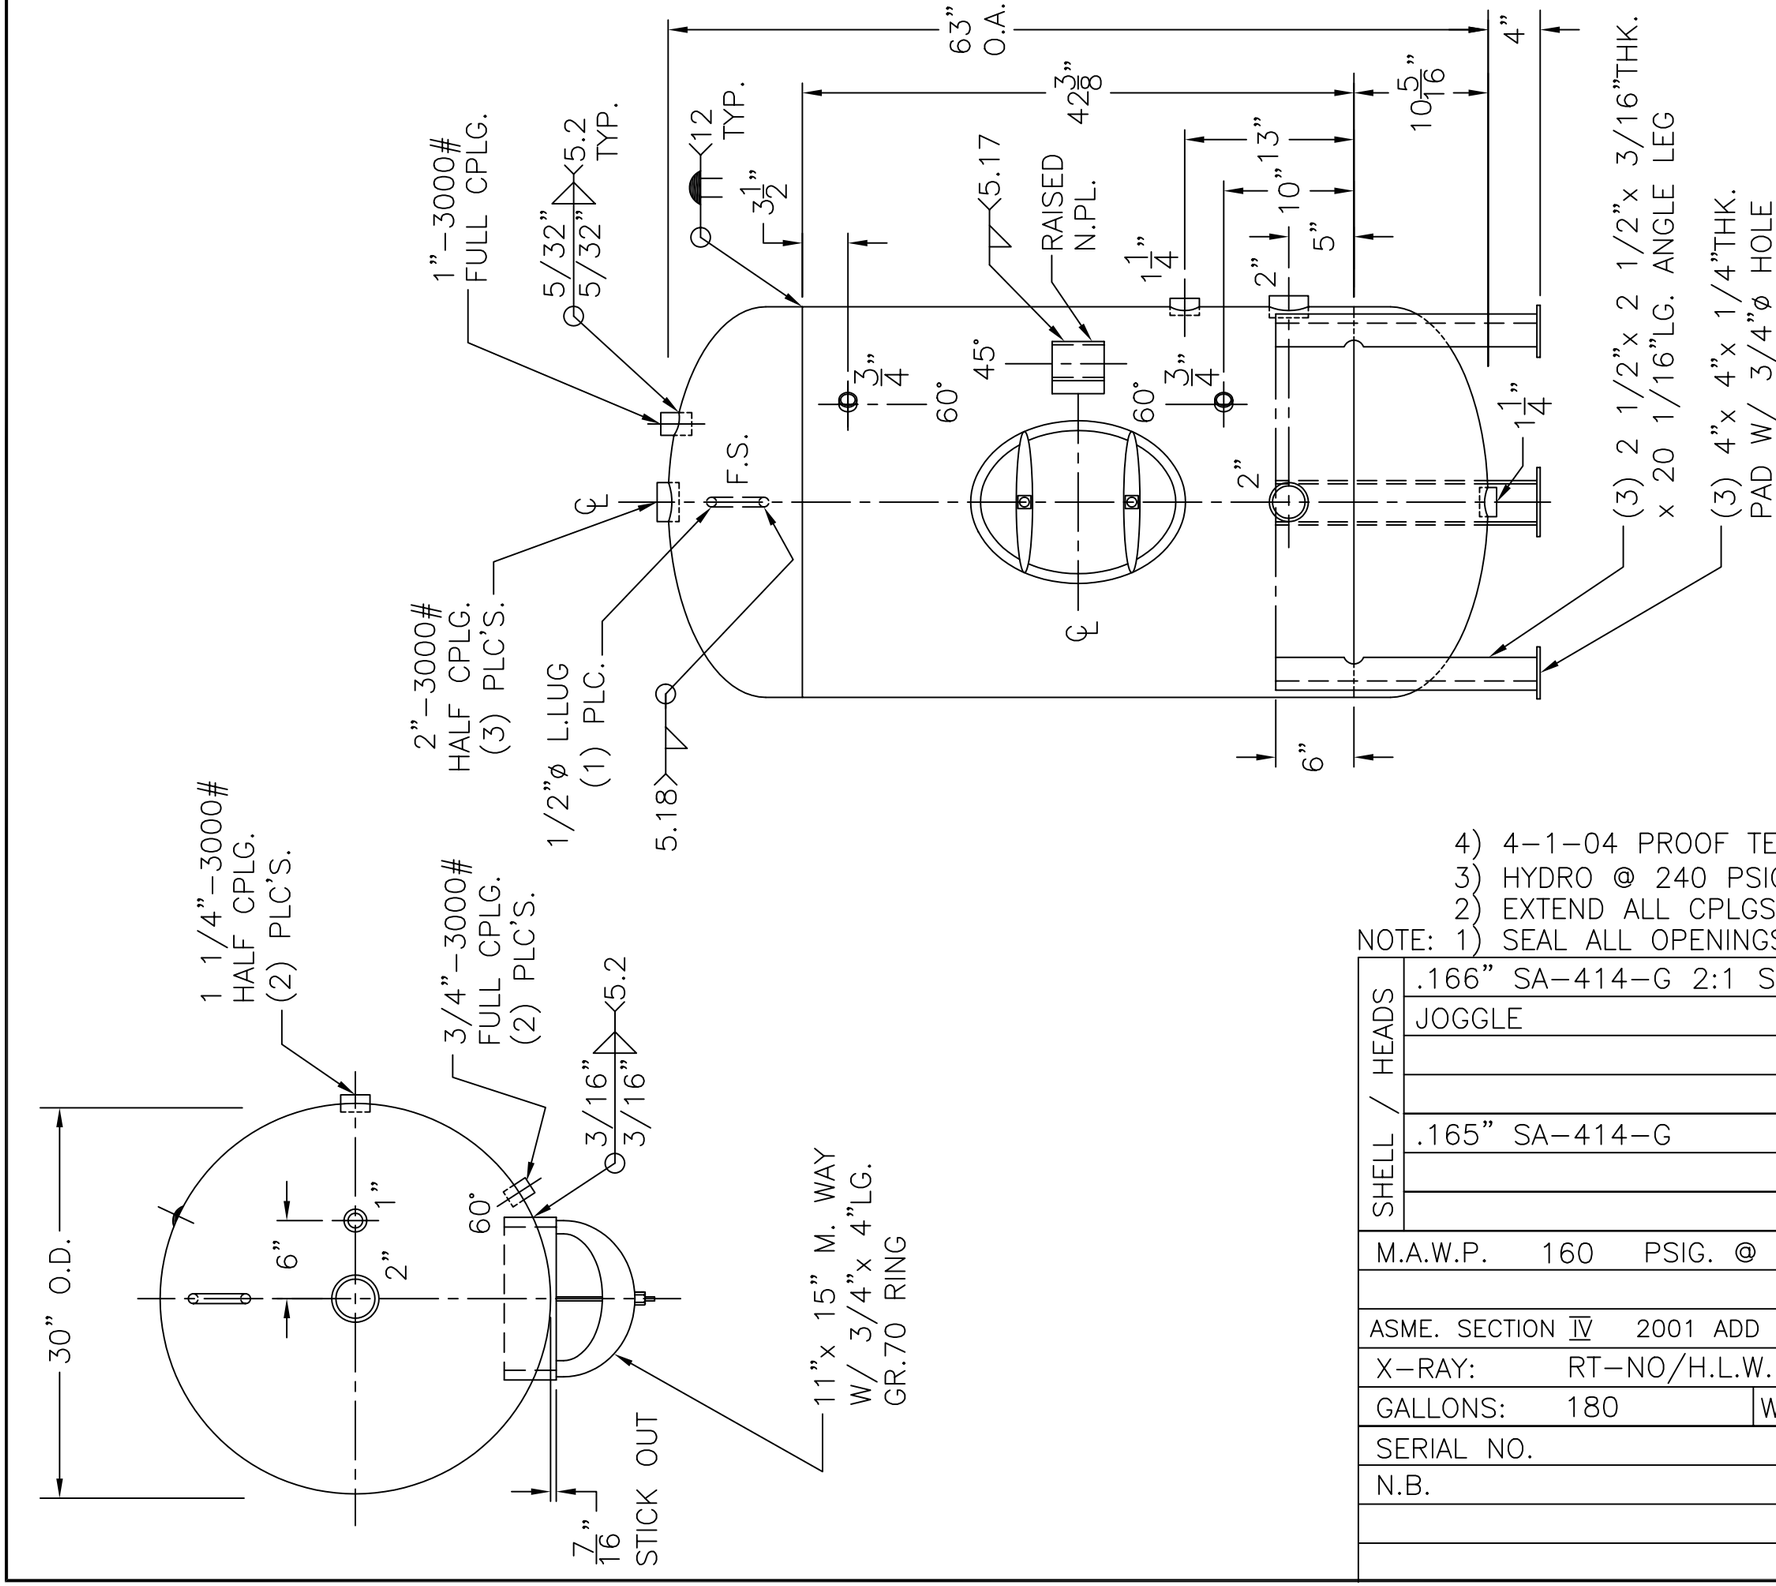

4) 4–1–04 PROOF TEST.
3) HYDRO @ 240 PSIG. MIN.
2) EXTEND ALL CPLGS. 5/8" INSIDE.

NOTE: 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.166" SA–414–G 2:1 S.E.	CS–30–180–V	REV. 10–6–04
	JOGGLE		DATE: 3–26–03
		FOR: HANSON STANDARD	
	.165" SA–414–G	VERT. HOT WATER TANK	
		44.4 SQ. FT. SURFACE AREA. THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.	
M.A.W.P. 160 PSIG. @ 210 °F		INSIDE: CEMENT LINED	
		OUTSIDE: PRIME	
ASME. SECTION IV 2001 ADD 2003		(161) LEG–ZONE 4–15 KM.	
X–RAY: RT–NO/H.L.W.		CAD–"B" UNDER "STD"–SERIES	
GALLONS: 180	WT. 705 LBS.	BY: E.S.	SCALE: 1"=12"
SERIAL NO.		ROY E. HANSON JR. MFG.	
N.B.		1924 COMPTON AVE. LOS ANGELES, CA 90011	